

GENERATION BRANDS, LLC TEST REPORT

SCOPE OF WORK

LED Performance Testing

MODEL NUMBER

ESSF0606P48225930WW1

PROJECT NUMBER

G104207161

REPORT NUMBER

104207161CRT-017

ISSUE DATE

10/2/2020

REVISED DATE

10/6/2020

TEST DATES

10/2/2020

DOCUMENT CONTROL NUMBER

RTTDS-R-AMER-Test-3407

© 2017 INTERTEK



REPORT NUMBER

104207161CRT-017

MODEL NUMBER(s)

ESSF0606P48225930WW1

REPORT RENDERED TO:

GENERATION BRANDS, LLC
7400 LINDER AVE
SKOKIE, IL 60077

STATEMENT OF LIMITATION

NVLAP Lab Code 100402-0. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government.

AUTHORIZATION

The testing performed was authorized by signed quote number Qu-01040731-2.

TEST STANDARDS

IESNA LM-79 - 2008: Electrical and Photometric Measurements of Solid State Lighting

ANSI NEMA ANSLG C78.377: 2017: Specifications for the Chromaticity of Solid State Lighting (SSL) Products

In Charge of Testing:



Melanie Brittain
Senior Associate Engineer
Lighting Division

Reviewer:



Jeff Davis
Technical Lead
Lighting Division

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

SAMPLE INFORMATION**REPORT NO. 104207161CRT-017****ITEMS RECEIVED**

Item No.	Control No.	Model No.	Description	Type	Received
1	CRT2009221018-002B	ESSF0606P48225930WW 1	Surface 0.6" x 0.6"	Production	9/22/2020

SUMMARY

REPORT NO. 104207161CRT-017

PRODUCT INFORMATION AND SUMMARY OF DATA

Product Model No.:	ESSF0606P48225930WW1
Product Description:	Surface 0.6" x 0.6"
LED Model No.:	Valent X ~250 lm/ft
Driver Model No.:	N/A
Light Source:	LED

Criteria	Results	
	Goniophotometer	Integrating Sphere
Light Output (lumens)	605.1	598.4
Input Power (W) @ 24 (Vdc)	9.12	9.07
Lumen Efficacy (lm/W)	66.4	66.0
Input Power Factor (I) @ 24 (Vdc)	--	--

Criteria	Results
Input ATHD (%) @ 24 (Vdc)	---
Correlated Color Temperature (K)	2949
Color Rendering Index - Ra (I)	97.4
Color Rendering Index - R9 (I)	96.6
Duv (I)	0.0015
Chromaticity Coordinate (x)	0.439
Chromaticity Coordinate (y)	0.402
Chromaticity Coordinate (u')	0.253
Chromaticity Coordinate (v')	0.521

TEST METHODS

SEASONING IN SAMPLE ORIENTATION - LED PRODUCTS

No seasoning was performed in accordance with IESNA LM-79.

INTEGRATING SPHERE TESTING

A spectroradiometer and integrating sphere were used to measure the spectral distribution for each EUT resulting in photometric and colorimetric data. Electrical measurements of the unit were measured using a power analyzer. Each EUT was operated at the rated input voltage of the system in its designated orientation. The ambient temperature was measured at a position inside the sphere and stabilization procedures to LM-79 were followed.

TYPE C GONIOPHOTOMETER DISTRIBUTION TESTING

A Type C Mirror Goniophotometer system was used to measure the luminous intensity (candela) at each angle of distribution for the EUT. Electrical measurements of the unit were measured using a power analyzer. Each EUT was operated at the rated input voltage of the system in its designated orientation. The ambient temperature was measured at a position near the EUT at equal height and stabilization procedures to LM-79 were followed.

TYPE C GONIOPHOTOMETER DISTRIBUTION TESTING

REPORT NO. 104207161CRT-017

PHOTOMETRIC AND ELECTRICAL MEASUREMENTS (25°C +/- 1°C)


Base Orientation	Input Voltage (Vdc)	Input Current (mA)	Input Power (W)	Input Power Factor ()
Up	24.06	379.0	9.12	--

Light Output (lm)	Lumen Efficacy (lm/W)
605.1	66.4

INTENSITY SUMMARY - CANDELA


Angle	0	22.5	45	67.5	90
0	212	212	212	212	212
5	213	211	211	211	212
10	210	208	209	208	209
15	205	203	204	203	204
20	198	196	197	197	198
25	189	187	188	188	189
30	179	178	178	179	180
35	168	166	167	167	168
40	155	154	155	154	155
45	141	140	140	140	140
50	126	126	125	125	125
55	109	109	109	109	109
60	92	93	92	92	93
65	74	74	74	75	76
70	55	56	57	58	59
75	37	38	40	42	43
80	20	21	24	27	28
85	5	8	12	15	16
90	0	0	3	6	7
95	0	0	0	1	2
100	0	0	0	0	0
105	0	0	0	0	0
110	0	0	0	0	0
115	0	0	0	0	0
120	0	0	0	0	0
125	0	0	0	0	0
130	0	0	0	0	0
135	0	0	0	0	0
140	0	0	0	0	0
145	0	0	0	0	0
150	0	0	0	0	0
155	0	0	0	0	0
160	0	0	0	0	0
165	0	0	0	0	0
170	0	0	0	0	0
175	0	0	0	0	0
180	0	0	0	0	0

Entire luminous intensity matrix found in .IES file

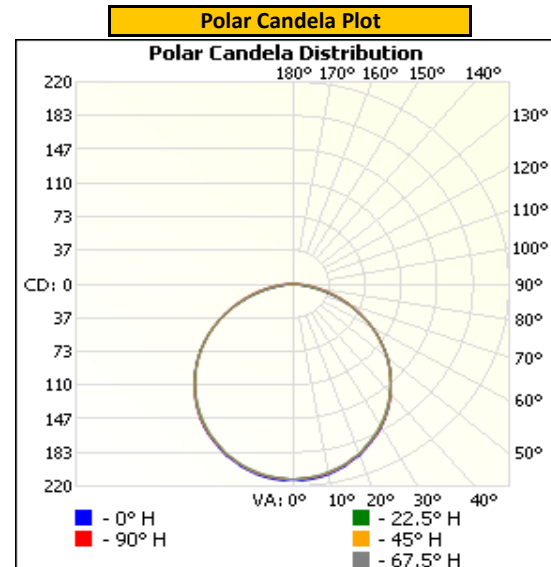

REPORT NO. 10420/161CRT-017

ILLUMINANCE SUMMARY

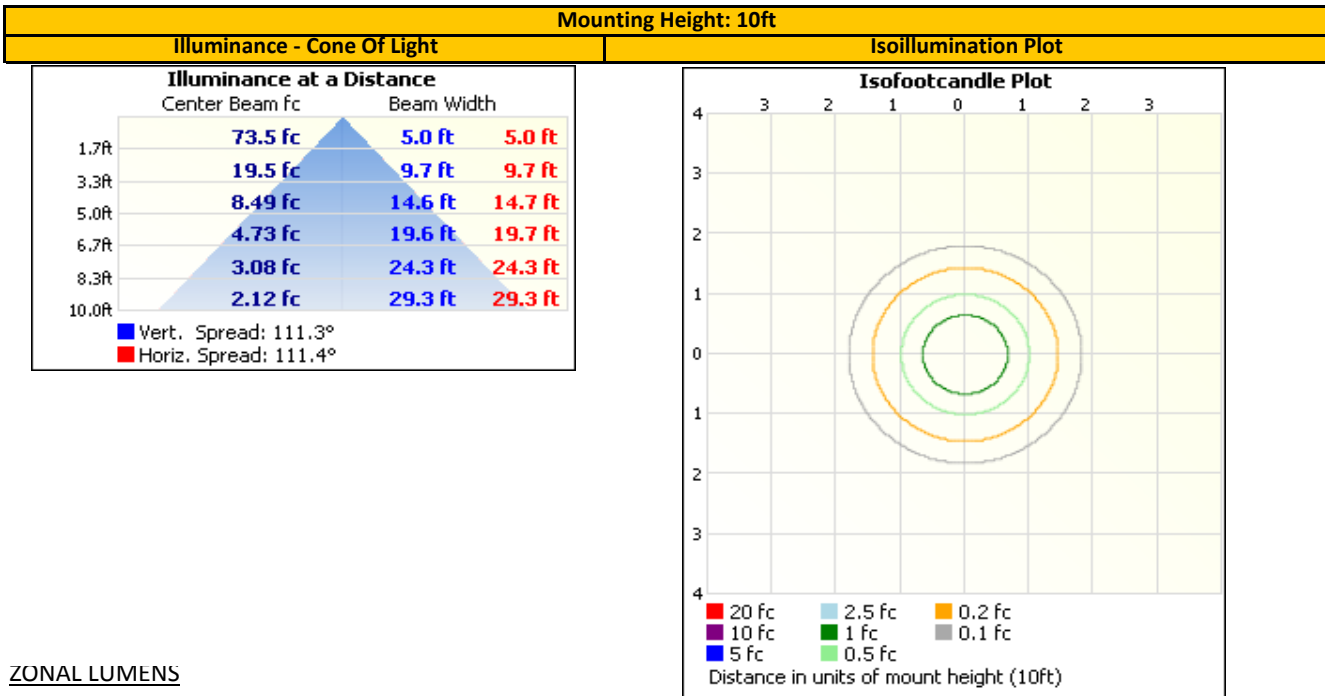

ZONAL LUMENS

Zonal Lumen Summary																																																																																																			
<table><tr><th>Zone</th><th>Lumens</th><th>Luminaire</th></tr><tr><td>0-30</td><td>164.2</td><td>27.1%</td></tr><tr><td>0-40</td><td>268.8</td><td>44.4%</td></tr><tr><td>0-60</td><td>474.5</td><td>78.4%</td></tr><tr><td>60-90</td><td>129.6</td><td>21.4%</td></tr><tr><td>70-100</td><td>56.6</td><td>9.3%</td></tr><tr><td>90-120</td><td>1.0</td><td>0.2%</td></tr><tr><td>0-90</td><td>604.1</td><td>99.8%</td></tr><tr><td>90-180</td><td>1.0</td><td>0.2%</td></tr><tr><td>0-180</td><td>605.1</td><td>100.0%</td></tr></table>			Zone	Lumens	Luminaire	0-30	164.2	27.1%	0-40	268.8	44.4%	0-60	474.5	78.4%	60-90	129.6	21.4%	70-100	56.6	9.3%	90-120	1.0	0.2%	0-90	604.1	99.8%	90-180	1.0	0.2%	0-180	605.1	100.0%	<table><tr><th>Zone</th><th>Lumens</th><th>Total</th><th>Zone</th><th>Lumens</th><th>Total</th></tr><tr><td>0-10</td><td>20.1</td><td>3.3%</td><td>90-100</td><td>1.0</td><td>0.2%</td></tr><tr><td>10-20</td><td>57.4</td><td>9.5%</td><td>100-110</td><td>0.0</td><td>0.0%</td></tr><tr><td>20-30</td><td>86.7</td><td>14.3%</td><td>110-120</td><td>0.0</td><td>0.0%</td></tr><tr><td>30-40</td><td>104.5</td><td>17.3%</td><td>120-130</td><td>0.0</td><td>0.0%</td></tr><tr><td>40-50</td><td>108.2</td><td>17.9%</td><td>130-140</td><td>0.0</td><td>0.0%</td></tr><tr><td>50-60</td><td>97.5</td><td>16.1%</td><td>140-150</td><td>0.0</td><td>0.0%</td></tr><tr><td>60-70</td><td>74.0</td><td>12.2%</td><td>150-160</td><td>0.0</td><td>0.0%</td></tr><tr><td>70-80</td><td>42.5</td><td>7.0%</td><td>160-170</td><td>0.0</td><td>0.0%</td></tr><tr><td>80-90</td><td>13.1</td><td>2.2%</td><td>170-180</td><td>0.0</td><td>0.0%</td></tr></table>							Zone	Lumens	Total	Zone	Lumens	Total	0-10	20.1	3.3%	90-100	1.0	0.2%	10-20	57.4	9.5%	100-110	0.0	0.0%	20-30	86.7	14.3%	110-120	0.0	0.0%	30-40	104.5	17.3%	120-130	0.0	0.0%	40-50	108.2	17.9%	130-140	0.0	0.0%	50-60	97.5	16.1%	140-150	0.0	0.0%	60-70	74.0	12.2%	150-160	0.0	0.0%	70-80	42.5	7.0%	160-170	0.0	0.0%	80-90	13.1	2.2%	170-180	0.0	0.0%
Zone	Lumens	Luminaire																																																																																																	
0-30	164.2	27.1%																																																																																																	
0-40	268.8	44.4%																																																																																																	
0-60	474.5	78.4%																																																																																																	
60-90	129.6	21.4%																																																																																																	
70-100	56.6	9.3%																																																																																																	
90-120	1.0	0.2%																																																																																																	
0-90	604.1	99.8%																																																																																																	
90-180	1.0	0.2%																																																																																																	
0-180	605.1	100.0%																																																																																																	
Zone	Lumens	Total	Zone	Lumens	Total																																																																																														
0-10	20.1	3.3%	90-100	1.0	0.2%																																																																																														
10-20	57.4	9.5%	100-110	0.0	0.0%																																																																																														
20-30	86.7	14.3%	110-120	0.0	0.0%																																																																																														
30-40	104.5	17.3%	120-130	0.0	0.0%																																																																																														
40-50	108.2	17.9%	130-140	0.0	0.0%																																																																																														
50-60	97.5	16.1%	140-150	0.0	0.0%																																																																																														
60-70	74.0	12.2%	150-160	0.0	0.0%																																																																																														
70-80	42.5	7.0%	160-170	0.0	0.0%																																																																																														
80-90	13.1	2.2%	170-180	0.0	0.0%																																																																																														

INTEGRATING SPHERE TESTING

REPORT NO. 104207161CRT-017

PHOTOMETRIC, COLORIMETRIC, AND ELECTRICAL MEASUREMENTS (25°C +/- 1°C)


Base Orientation
Up

Input Voltage (Vdc)	Input Current (mA)	Input Power (W)	Input Power Factor (l)	Input ATHD (%)
24.00	378.0	9.07	--	---

Measured at 24(Vdc)

Light Output (lm)	Lumen Efficacy (lm/W)	CCT (K)	CRI - Ra (l)	CRI - R9 (l)
598.4	66.0	2949	97.4	96.6


Duv (l)	1931 Chrom (x)	1931 Chrom (y)	1976 Chrom (u')	1976 Chrom (v')
0.0015	0.439	0.402	0.253	0.521

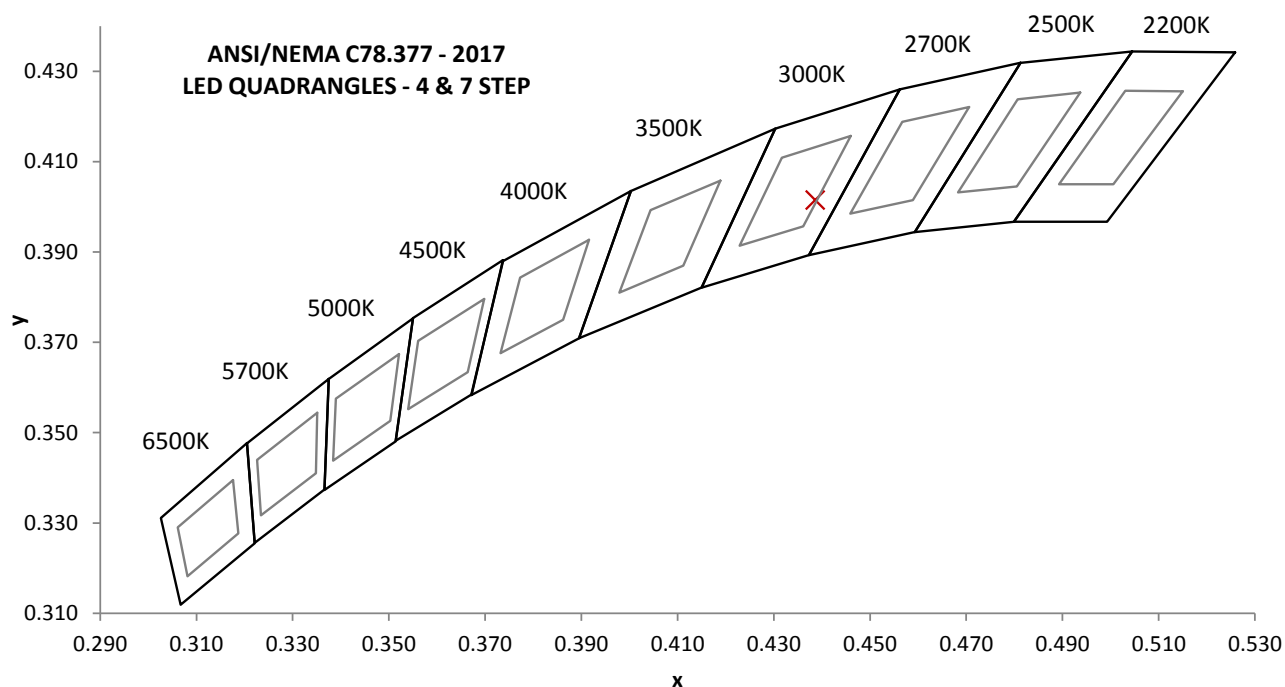

REPORT NO. 104207161CRT-017

SPECTRAL DISTRIBUTION OVER WAVELENGTHS

nm	mW/nm		nm	mW/nm		nm	mW/nm		nm	mW/nm
350	0.3		460	4.5		570	8.3		680	8.7
355	0.0		465	4.3		575	8.4		685	7.9
360	0.3		470	3.6		580	8.7		690	7.1
365	0.1		475	3.0		585	8.9		695	6.4
370	0.1		480	3.1		590	9.3		700	5.5
375	0.0		485	3.4		595	9.7		705	5.0
380	0.1		490	3.8		600	10.2		710	4.3
385	0.1		495	4.2		605	10.8		715	3.8
390	0.0		500	4.7		610	11.3		720	3.3
395	0.0		505	5.2		615	12.0		725	2.9
400	0.0		510	5.6		620	12.5		730	2.5
405	0.1		515	6.0		625	13.0		735	2.2
410	0.1		520	6.3		630	13.4		740	1.9
415	0.1		525	6.6		635	13.5		745	1.6
420	0.1		530	6.9		640	13.4		750	1.4
425	0.2		535	7.2		645	13.3		755	1.2
430	0.5		540	7.4		650	12.9		760	1.0
435	0.9		545	7.6		655	12.4		765	0.9
440	1.8		550	7.8		660	11.9		770	0.8
445	3.9		555	7.9		665	11.1		775	0.6
450	6.7		560	8.1		670	10.3		780	0.5
455	5.9		565	8.2		675	9.5		---	---

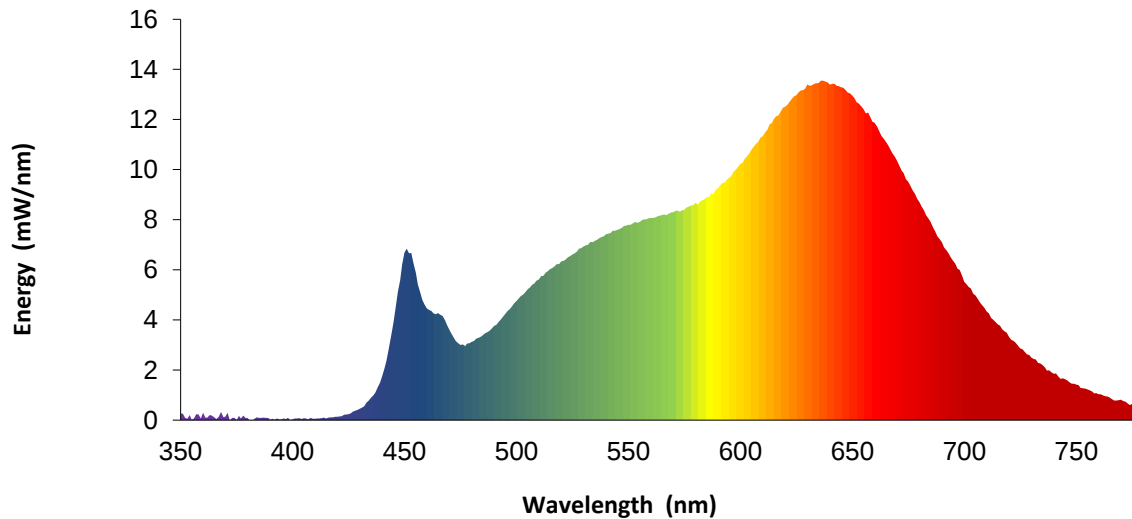

Portrayed color in graphic is estimated by wavelength (nm) and may not be exact - it is a visual representation only

EQUIPMENT LIST

REPORT NO. 104207161CRT-017

#	Equipment	Model No	Control No.	Last Cal	Cal Due
1	LSI High Speed Mirror Goniometer	6440	---	9/21/2020	10/21/2020
2	Elgar AC Power Supply	CW1251	---	VBV	VBV
3	Yokogawa Power Analyzer	WT210	E464	5/11/2020	5/11/2021
4	Traceable Hygrothermometer	4800	L203	2/17/2020	2/17/2021
5	M-D Building Products Digital Level	Smart Tool	307-L112	5/14/2020	5/14/2021
6	NIST Luminous Intensity Standard Source	NBS10322	N1427	2/11/2019	2/11/2021
7	NIST Luminous Intensity Standard Source	NBS10332	N1435	2/11/2019	2/11/2021
8	NIST Luminous Intensity Standard Source	NBS10265	N1437	2/11/2019	2/11/2021
9	NIST Luminous Flux Standard Source	NBS10428	N1424	1/3/2019	1/3/2021
10	Sorenson DC Power Supply	XG 150-10	---	VBV	VBV
11	Omega Thermometer	DPI8-C24	M263	2/27/2020	2/27/2021
12	2M Integrating Sphere Spectrometer System	CDS 600	W/N308	9/30/2020	10/30/2020
13	Yokogawa Power Analyzer	WT1600	E475	8/10/2020	8/10/2021
14	Digital Thermometer	Fluke 53 II	307-D587	1/23/2020	1/23/2021
15	Xantrex DC Power Supply	XTR 150-5.6	---	VBV	VBV
16	Elgar AC Power Supply	CW1251	---	VBV	VBV
17	Secondary Spectral Intensity Standard Source	BS5186	RF5186	11/21/2019	11/21/2020
18	Secondary Flux Standard Source	6836	---	2/11/2020	2/11/2021
19	Secondary Flux Standard Source	4116	---	2/11/2020	2/11/2021
20	Secondary Flux Standard Source	3616	---	2/11/2020	2/11/2021
21	Fisher Scientific Digital Stopwatch	130471471	307-N1404	3/19/2020	3/19/2021

Note: Standard sources listed above are traceable to NIST: National Institute of Standards and Technology

REVISION HISTORY

#	Revision Date	Updated By	Reviewed By	Description of Change
1	10/6/2020	Melanie Brittain	Jeff Davis	Report revised to correct luminaire model number.
---	---	---	---	---
---	---	---	---	---